


SCHAFFNERMTC transformers

DRY TYPE TRANSFORMER

| | | | | | | |
|------|-----------------------|-------|-------|-------|--------------------------|------------------------|
| SN | 361000K09HC01 - XXXXX | | | DATE | X/XX | IMP X.XX% @170°C |
| KVA | 1000 | PHASE | 3 | HERTZ | 60 | |
| TYPE | AA | RISE | 150°C | CLASS | H | 220°C INS |
| PRI: | 4160GrdY/2402 | AMPS | 138.8 | BIL | 30 | CU COND |
| SEC: | 13800GrdY/7968 | AMPS | 41.8 | BIL | 95 | CU COND |
| TAPS | VOLTS | | AMPS | | CORE & COIL WT. | |
| 1-2 | 14490 | | 39.8 | | | |
| 2-3 | 14145 | | 40.8 | | | |
| 3-4 | 13800 | | 41.8 | | XXXX LBS. | |
| 4-5 | 13455 | | 42.9 | | APPROXIMATE TOTAL WT. | |
| 5-6 | 13110 | | 44.0 | | | |
| 6-7 | | | | | | |
| 7-8 | | | | | XXXX LBS. | |

CAUTION: DE-ENERGIZE TRANSFORMER BEFORE CHANGING TAPS

K-FACTOR: 4
SUITABLE FOR STEP-UP OPERATION

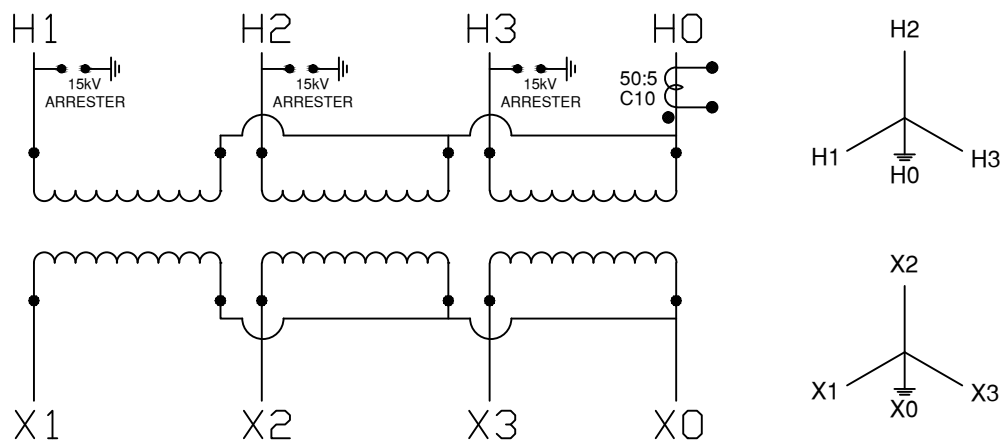

INSTRUCTION BOOK NO. INST-001

MANUFACTURED WITH PRIDE IN
WYTHEVILLE, VA, USA 24382