

**+BRS01
120V-208V PANEL BOARD**

-CB 15A	
25	L1
N	N
GND	GND
	SPARE

-CB 15A	
26	L1
N	N
GND	GND

-CB 20A	
27	L1
N	N
GND	GND

-CB 20A	
28	L1
N	N
GND	GND



-CB 20A	
29	L1
N	N
GND	GND

-CB 20A	
31	L1
N	N
GND	GND

-CB 20A	
32	L1
N	N
GND	GND


-CB 20A	
33	L1
N	N
GND	GND

-CB 40A	
34	L1
N	N
GND	GND

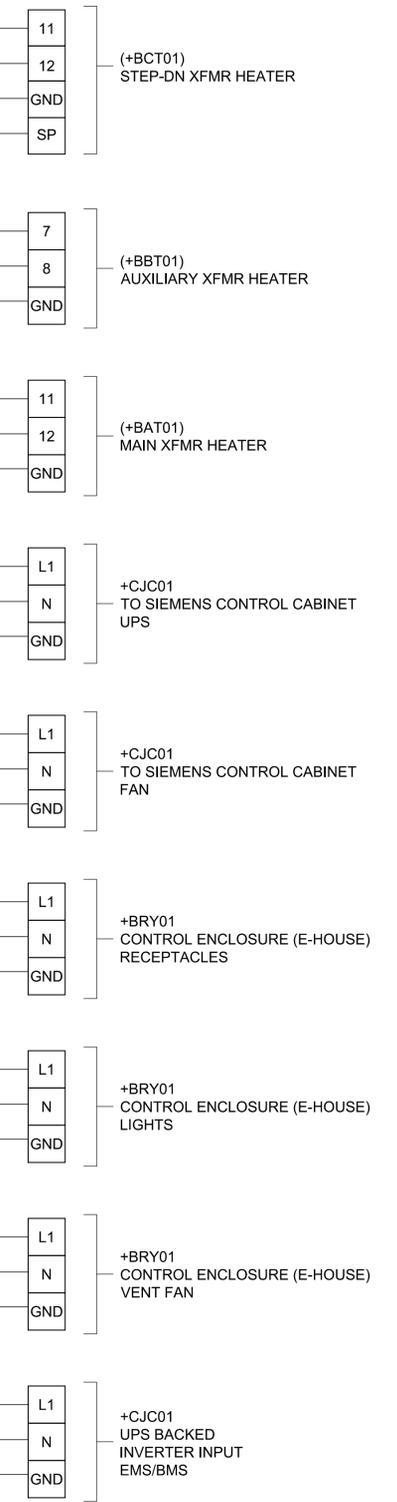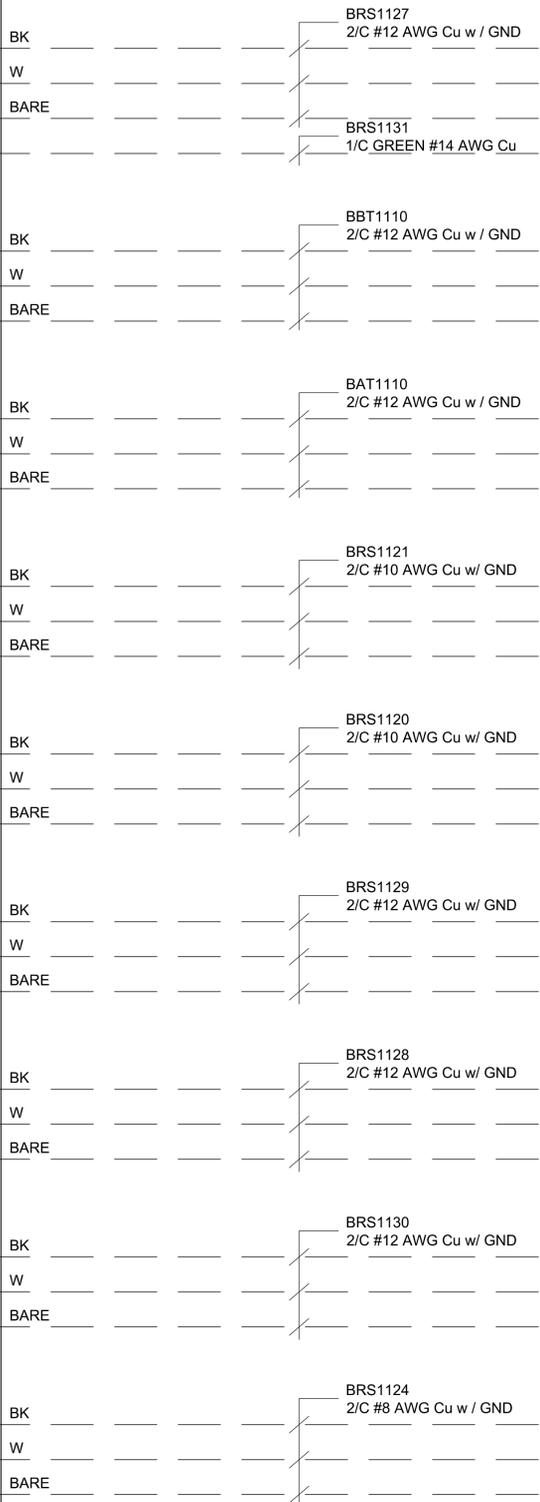

NOTE:
SPARE BREAKERS AVAILABLE. SEE LAYOUT ON THREE-LINE, DWG. MAN17077-D-3103

**ISSUED FOR CONSTRUCTION
OCT 15, 2018**



VIONX ENERGY - 905-0522 BATTERY STORAGE SYSTEM SHIRLEY, MA			
DRAFTER: JBH	ENGR: LO	DATE: 22 SEP 17	
CHECKER: MB	APPD: SDE	SCALE: NO SCALE	
REV	DATE	DESCRIPTION	
0	15 OCT 18	ISSUED FOR CONSTRUCTION	

**E3000-ESS - ENERGY STORAGE SYSTEM
EXTERNAL CONNECTION DIAGRAM**

DRAWING NO. MAN17077-D-5506	REV. 0
--------------------------------	-----------